



STAKKAbOX ULTIMA 1310mm x 610mm : EN124 CLASS D400 40 TONNES



Bodycote MATERIALS TESTING DAVENTRY
METAL TECHNOLOGY

BODYCOTE MATERIALS TESTING LTD • 8-14 HIGH MARCH • DAVENTRY • NORTHANTS • NN11 4HB TEL: 01327 702964 FAX: 01327 871119
• WEBSITE: www.bodycote.com



UKAS
TESTING
No. 0087

TEST CERTIFICATE

C4 Industries Ltd
Yardley Road
Knowsley Road
Kirkby
Liverpool
L33 7SS

Ref No. N002559/3
Order No. N/A


Date Tested: 23/05/02
Date Reported: 15/06/02

ITEM: **1310 x 610mm Stakkabox Ultima Chamber.** Consisting of 5 similar rectangular interlocking sections resulting in a total assembled chamber height of 760mm. Given a Bodycote ref T31484.

SPECIFICATION: Tested to the load levels indicated in the BS EN124 for class D400 gully and manhole tops. *Note that BS EN124 is specifically for manhole and gully tops and as such no pass/fail criteria can be applied to this component. The method of transferring load into the component is specific to this component and does not follow the requirements of the BS EN124. The results of these tests in no way infer approval or otherwise to the requirements of the standard.*

RESULT:				
Sample	2/3 max test load Five times (kN)	Max test load for 30 seconds (kN)	Displacement difference 1 st to 5 th load (mm)	Displacement at max test load (mm)
T31484	266	-	0.19	-
T31484	-	400	-	3.1

Loaded 5 times to 266kN and once to 400kN and held for 30 seconds

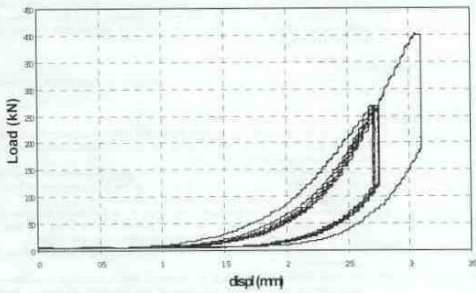


Graph showing Load (kN) on the y-axis (0 to 40) and displacement (mm) on the x-axis (0 to 35). The graph displays multiple curves representing test results, showing a non-linear relationship between load and displacement, with a sharp increase in load as displacement approaches 30mm.

COMMENTS:
The test sample achieved the maximum load with no visible detriment to its condition. The maximum permanent set permissible for a manhole cover or grating based upon BS EN124 is stated as 1/300 x minimum clear opening i.e. 2.5mm. The maximum permanent set seen here (0.19mm) does not represent a significant contribution to this level. Further information detailing the method of test for this and other samples are given in Bodycote report ref:2559/1.

Copy No **2**

Tested By L.E.David
Reported By L.Best

Signed 

L. C. BEST

Senior Project Engineer

Bodycote Materials Testing Ltd

ISSUED UNDER NAMAS REGISTRATION 0087. Accreditation granted by UKAS (United Kingdom Accreditation Service). Certified that the samples have been tested in accordance with the contract/order applicable thereto and with the requirements of the standard/conditions quoted herein. The quality control arrangements adopted have accorded with the conditions of the National Accreditation of Measurement and Sampling (NAMAS). This does not guarantee the bulk of the items/material to be of equal quality.

The contents of this report are governed by the terms and conditions overleaf